


NOTE:

- TOP OF 4' TAPER SHALL BE 1' MIN. FROM LOT LINE EXTENDED
- EACH DRIVEWAY PANEL NOT TO EXCEED 100 SF.
- REINFORCEMENT BARS OR WELDED WIRE FABRIC (STEEL MESH) ARE NOT ALLOWED IN THE RIGHT-OF-WAY
- CLASS 5 AGGREGATE BASE REQUIRED UNDER CURB AND GUTTER.

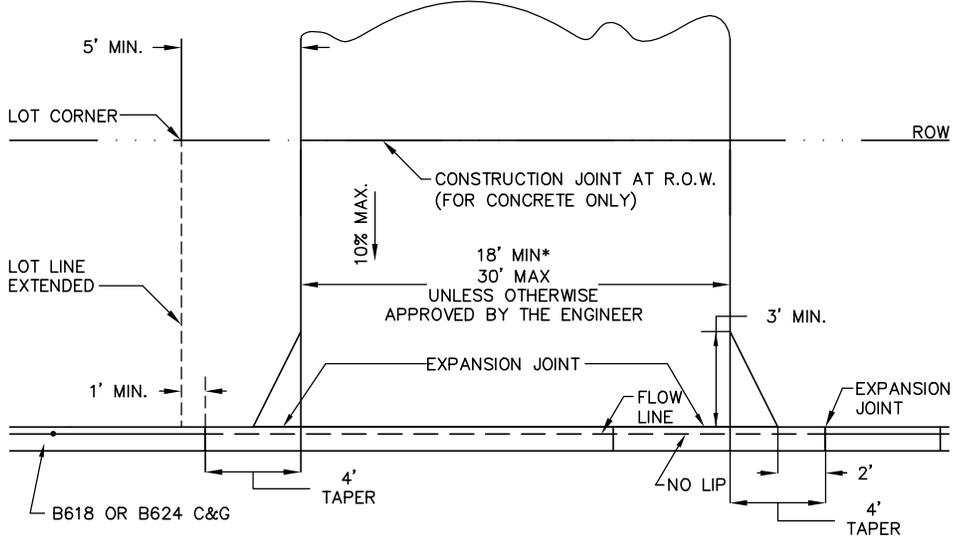

* FOR NEW DRIVEWAY APPROACH LOCATIONS ONLY. THIS DOES NOT APPLY TO REPLACEMENT OR OVERLAY OF EXISTING DRIVEWAYS

102 - RESIDENTIAL DRIVEWAY APPROACH
 102 - Drwy (Residential).dwg 5/2015

H:\Cad_Comm\Details Updated\0 - STREET\102 - Drwy (Residential)



**ENGINEERING DIVISION
 PUBLIC WORKS DEPARTMENT**

PLATE NAME:

102 - Drwy (Residential)

LAST REVISED: 6/5/2015

LAST REVISED BY: KBO